

DN 75 Double Seal Two-Way Side Outlet

CASTCO

香港粉嶺安居街33號
香港粉嶺安全街29A號
E-mail: info@castco.com.hk

佳力高試驗中心有限公司
CASTCO TESTING CENTRE LIMITED

33, On Kui Street, Fanling, Hong Kong.
29A, On Chun Street, Fanling, Hong Kong.
Website: www.castco.com.hk

Tel : 2597 8393
Fax: 2597 3399



Test Report Dimension check on discharge and ventilating pipes and fittings, sand-cast or spun in cast iron (Based on BS416 : Part 1 : 1990, Clause 4)

Date of issue : 12 December 2017

Page 1 of 1 page(s)

Castco LRN : DP0171010-042 DIM

Details as supplied by customer

Customer: Cheung Hing Foundry (HK) Limited

Customer's ref. no. : --

Address: 299 Pak Sha Tuen, Kung Um Road, Yuen Long, N.T. Hong Kong

Contract no. : --

Job title : --

Sample description : DN75 Rainwater Two-Way Side Double Seal Series Outlet with (S5316 or C.I.) Elbow/Slant Grating

Manufacturer : Cheung Hing Foundry (HK) Limited

Brand : CHF

Remark: Sample Submitted by: Asia Development (HK) Ltd

Laboratory test result



Date sample received : 10 October 2017

Date of test : 27 November 2017

Dimensions Check

Specimen no. : 5

Dimensions	BS requirement from figure --	Product requirement from code no. --	Measured mean value
D	≥74mm	75mm	77mm
T	5 (+0/-1.5)mm	--	4.24mm
OD	--	83mm	83mm
A	--	300mm	305mm
A1	--	130mm	128mm
B1	--	150mm	150mm
B2	--	100mm	100mm
H	--	177mm	178mm
W1	--	222mm	225mm
W2	--	165mm	160mm
b1	--	150mm	150mm
b2	--	100mm	100mm



Remarks : 1. Test result relates only to the specimen tested.
2. Test results of the sample comply with the requirement of BS416 : Part 1 : 1990, Clause 4.

Checked by :

SIT KWAN NING
Laboratory Supervisor

Approved Signatory :

End of Report

WONG KA MAN
Senior Manager

DN 100 Double Seal Two-Way Side Outlet

CASTCO

香港粉嶺安居街33號
香港粉嶺安全街29A號
E-mail: info@castco.com.hk

佳力高試驗中心有限公司
CASTCO TESTING CENTRE LIMITED

33, On Kui Street, Fanling, Hong Kong.
29A, On Chuen Street, Fanling, Hong Kong.
Website: www.castco.com.hk

Tel : 2597 8388
Fax: 2597 8399



Test Report Dimension check on discharge and ventilating pipes and fittings, sand-cast or spun in cast iron (Based on BS416 : Part 1 : 1990, Clause 4)

Date of issue : 12 December 2017

Page 1 of 1 page(s)

Castco LRN : DP0171010-043 DIM

Details as supplied by customer

Customer: Cheung Hing Foundry (HK) Limited

Customer's ref. no. : --

Address: 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, N.T. Hong Kong

Contract no. : --

Job title : --

Sample description : DN100 Rainwater Two-Way Side Double Seal Series Outlet with (SS316 or C.I.) Elbow/Slant Grating

Manufacturer : Cheung Hing Foundry (HK) Limited

Brand : CHF

Remark: Sample Submitted by: Asia Development (HK) Ltd

Laboratory test result



Date sample received : 10 October 2017

Date of test : 27 November 2017

Dimensions Check

Specimen no. : 6

Dimensions	BS requirement from figure --	Product requirement from code no. --	Measured mean value
D	100mm	100mm	102mm
T	5 (+0/-1.5)mm	--	4.25mm
OD	--	110mm	110mm
A	--	300mm	300mm
A1	--	130mm	125mm
B1	--	150mm	145mm
B2	--	100mm	100mm
H	--	177mm	180mm
W1	--	165mm	160mm
W2	--	222mm	225mm
b1	--	150mm	150mm
b2	--	100mm	100mm

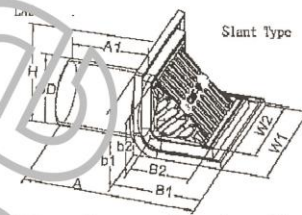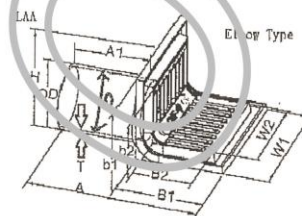

- Remarks : 1. Test result relates only to the specimen tested.
2. Test results of the sample comply with the requirement of BS416 : Part 1 : 1990, Clause 4.

Checked by :

SIT KWAN NING
Laboratory Supervisor

Approved Signatory :

End of Report

WONG KA MAN
Senior Manager

DN 150 Double Seal Rainwater Outlet

CASTCO**佳力高試驗中心有限公司
CASTCO TESTING CENTRE LTD.**

香港粉嶺安居街33號 37, O. Kui Street, Fanling, Hong Kong. Tel: 2677 2138
香港粉嶺安全街29A號 29A, On Chun Street, Fanling, Hong Kong. Fax: 2677 0351
E-mail: castco@netvigator.com Website: www.castco.com.hk



Test Report

**Dimension check on discharge and ventilating pipes
and fittings, sand-cast or spun in cast iron**
(Based on BS416 : Part 1 : 1990, Clause 4)

Date of issue : 01 September 2016

Page 1 of 1 page(s)

Castco LRN : DP0160823-106 DIM

Details as supplied by customer

Customer: Cheung Hing Foundry (HK) Limited

Customer's ref. no. : --

Address: P.O. Box 1323, Yuen Long Delivery Office, Yuen Long

Contract no. : Job title : --

Sample description : DN150 Rainwater Double Seal Series Outlet with Elbow / Slant Grating

Manufacturer : Cheung Hing Foundry (HK) Limited

Brand : CHF

Remark : Sample submitted by : Asia Development (HK) Limited

Sample marking : BS416 150 CHF

Laboratory test result


Date sample received : 23 August 2016

Date of test : 31 August 2016

Dimensions Check

Specimen no. : DP0160823-106

Dimensions	BS requirement from figure --	Product requirement from code no. LAA150 / LA3150	Measured mean value
A	--	340 mm	336 mm
A1	--	100 mm	105 mm
B	--	290 mm	290 mm
C	--	260 mm	260 mm
D	--	200 mm	200 mm
T	5 (+0.0 / -1.5) mm	5 mm	4.75 mm
X	--	140 mm	140 mm
W	--	210 mm	212 mm
H	--	155 mm	153 mm
DN	≥150 mm	150 mm	150 mm

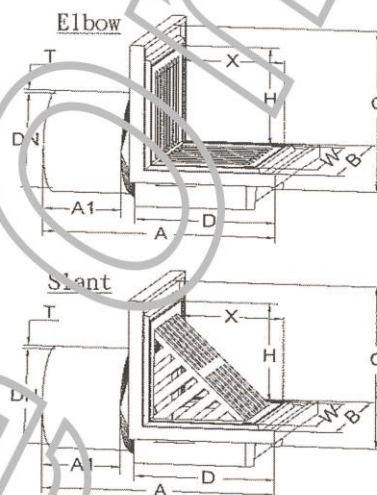

- Remarks :
1. Test result relates only to the specimen tested.
 2. Compliance of the test results to the specification is an opinion of the laboratory and is not covered under the HOKLAS accreditation.
 3. Test results of the sample comply with the requirement of BS416 : Part 1 : 1990, Clause 4.

Checked by :

SIT KWAN NING

Laboratory Supervisor

Approved Signatory :

End of Report

WONG KA MAN
Laboratory Manager

Form No. PIPE DIM 16_T, Issued 20/08/2015

Item no. DP/0501