


Test Report

Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]Date of issue : 23 June 2021
Page 2 of 2 page(s)

Castco LRN : 210616

Appendix

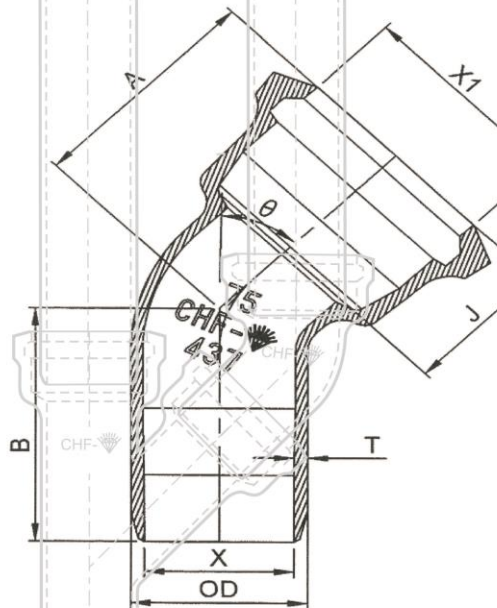

Form No. PIPE DIM437_2008 T1.dwg 16/2019 CHF-04

香港粉嶺安樂街33號得利中心
香港粉嶺安樂街30號新寧中心
香港粉嶺安樂街29號
Tel: 2597 8333 Fax: 2597 8399香港粉嶺安樂街33號 33 On Kui Street, Fanling, Hong Kong. Tel: 2597 8333
香港粉嶺安樂街29A號 29A On Chuen Street, Fanling, Hong Kong. Fax: 2597 8399
E-mail: info@castco.com.hk Website: www.castco.com.hk

Test Report

Dimension and Mass of Cast Iron Drain Pipe, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]

Date of issue : 23 June 2021

Page 1 of 2 page(s)

Castco LRN : 210616-2547-001 DIM

Details as supplied by customer

Customer : Cheung Hing Foundry (HK) Limited

Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Job title : --

Sample description : DN75 x 45° Bend with Flexible Joint

Manufacturer : Cheung Hing Foundry (HK) Limited

Brand name : CHF

Nominal bore : 75 mm

Nominal Length : --

Nominal Mass : 5.2 kg

Type of joint : Flexible joint

Laboratory test result

Date sample received : 16 June 2021

Date of test : 17 June 2021

Dimensions Check

Specimen no. : 210616-2547-001

Dimensions	Requirement from figure --	Product requirement from code no. --	Measured mean value
A	--	130 mm	135 mm
B	--	140 mm	140 mm
J	--	84 mm	88 mm
OD	--	91 mm	89 mm
T	--	6.5 mm	7.00 mm
X	--	75 mm	75 mm
X1	--	113 mm	115 mm
Mass	2(-0.8) kg	5.2 kg	5.42 kg

Remarks : 1. Test result relates only to the specimen tested.
2. Compliance check against BS 437 : 2008, Annex A2 to A9, Clause 4.3 & 4.4 was not possible as this pipe could not be found in the standard.
3. Sample submitted by : Asia Development (HK) Limited.
Country of Origin : China.
Test result complies with the requirement of BS437 : 1978 Clause 5 & figure 1b for dimension A.
The sample curve shall be within grading zone. The acceptance limit is the same as the tolerance limit.
Limit acceptance, see Figure A. Only test results out of the acceptance limit will be concluded as out-of-tolerance.

Test Certificate

Hydrostatic test on Cast Iron Pipe

(In-house method in accordance with BS 437 : 2008 Clause 1)

Date of issue : 23 June 2021

Page 1 of 1 page

Castco LRN : 210616-2547-001 HYD

Details as supplied by client

Customer : Cheung Hing Foundry (HK) Limited

Customer's ref. no. : --

Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Job title : --

Contract no. : --

Sample description : DN75 x 45° Bend with Flexible Joint

Brand name : CHF

Manufacturer : Cheung Hing Foundry (HK) Limited

Laboratory Test Result

Date received : 16 June 2021

Date of test : 17 June 2021

Specimen no.	210616-2547-001
Actual internal hydrostatic pressure applied (bar)	3.5
Sustain period (sec)	30
Test result	Passed

Remarks : 1. Test results relate only to the specimen tested.
2. Sample Submitted by : Asia Development (HK) Limited.
3. Country of Origin : China.

Checked by:
SIT KWAN NING
Senior SupervisorCertified by:
WONG KA MAN
Senior Manager

Form No. PIPE HYD In-house_T1.dwg 03/06/2020 /04

DIM

DIM

HYD

Test Report

Metallic Materials (Steel - Structural) - Brinell Hardness Test
(BS EN ISO 6506: Part 1: 1999)

Date of issue: 23 June 2021

Page 1 of 2 pages

Castco LRN: 210616-2547-001 BH

Details as supplied by customer:

Customer: Cheung Hing Foundry (HK) Limited

Customer's ref. no.

Address: 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Contract no.: --

Job title: --

Test piece description: DN75 x 45° Bend with Flexible Joint

Acceptance standard: BS 437: 2008 Clause 4.5 Table 4

Test piece no.: 1

Test results:

Date received: 16 June 2021

Date of test: 18 June 2021

Test specimen thickness: 10.37 mm

Test temperature: 25 °C

Sketch of Test locations



Form No. NDT(IST) BH_MTL_T1 d6 06/11/2018 /04

HKAS has accredited this laboratory (Reg. No. HOKLAS 032) under HOKLAS for specific laboratory activities as listed in the HOKLAS directory of accredited laboratories. This report shall not be reproduced except in full, without written approval from this laboratory. Only the original copy or the laboratory's certified true copy is valid.

Test Report

Metallic Materials - Tensile Test of Metallic Materials
(BS EN 10002-1: 2001)

Date of issue: 23 June 2021

Page 1 of 1 page

Castco LRN: 210616-2547-001 TEN

Details as supplied by customer:

Customer: Cheung Hing Foundry (HK) Limited

Customer's Ref. No.: --

Address: 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Contract No.: --

Job Title: --

Origin of steel: --

Supplier: --

Grade / Form of steel product: --

Location in works: --

No. / Type of specimen supplied: 1 no. DN75 x 45° Bend with Flexible Joint

Acceptance standard: BS 437: 2008 Clause 4.5 Table 4

Nominal thickness: 11.36 mm

Laboratory Test Result

Date Received: 16 June 2021

Date Tested: 18 June 2021

Tensile Test

Specimen Identity	Grade	Type & Preparation	Width (mm)	Thickness (mm)	Org. X-sect Area (mm ²)	Org. Gauge Length (mm)	Yield Strength (MPa)	Tensile Strength (MPa)	Elongation (%)	Position of Fracture	Remark
210616-2547-001	--	--	8.04	11.38	91.46	--	--	198	--	Valid	--

Remarks:

1. Legend: A - Proportional; B - Non-proportional; M - Machined; N - Unmachined;

+ This measurement is 'invalid' when it refers to the position of fracture only.

2. Test results relate only to the specimen tested.

3. Test results comply with BS 437: 2008 Clause 4.5 Table 4.

4. Sample Submitted by: Asia Development (HK) Limited.


5. Country of Origin: China.

Brand name: CHF

Manufacturer: Cheung Hing Foundry (HK) Limited.

6. Test result complies with the requirement of BS 437: 1978 Clause 5 & figure 1b for dimensions.

The sample curve shall be within grading zone. The acceptance limit is the same as the tolerance limit (simple acceptance, see Figure A) Only test results out of the acceptance limit will be concluded as out-of-tolerance.



Checked by:

SIT KWAN NING
Senior Supervisor

Approved Signature:

End of Report

WONG KA MAN
Senior Manager

Form No. ST-BSEN 10002-1:2001 T2 d6 12/05/2017 /04


HKAS has accredited this laboratory (Reg. No. HOKLAS 032) under HOKLAS for specific laboratory activities as listed in the HOKLAS directory of accredited laboratories. This report shall not be reproduced except in full, without written approval from this laboratory. Only the original copy or the laboratory's certified true copy is valid.

Test Report
Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]

Page 2 of 2 page(s)

Castco LRN : 201130

Appendix

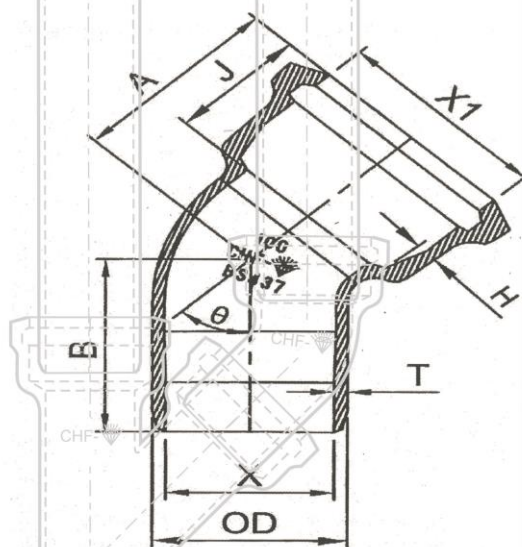香港粉嶺安居街33號
香港粉嶺安全街29A號
E-mail: info@castco.com.hk33, On Kui Street, Fanling, Hong Kong.
29A, On Chuen Street, Fanling, Hong Kong.
Website: www.castco.com.hkTest Report
Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]

Date of issue : 17 December 2020

Page 1 of 2 page(s)

Castco LRN : 201130-2279 DIM

Details as supplied by customer

Customer : Cheung Hing Foundry (HK) Limited
Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong
Job title : --
Sample description : DN100 x 45° Bend with Flexible Joint
Manufacturer : Cheung Hing Foundry (HK) Limited
Brand name : CHF
Nominal bore : 100 mm
Nominal Length : --
Nominal Mass : 8 kg
Type of joint : Flexible joint

Customer's ref. no. : --

Contract no. : --

Laboratory test result

Date sample received : 30 November 2020

Date of test : 01 December 2020

Dimensions Check

Specimen no. : 201130-2279

Dimensions	BS requirement from figure --	Product requirement from code no. --	Measured mean value
A	--	140 mm	145 mm
B	--	140 mm	140 mm
H	--	14 mm	12.73 mm
J	--	80 mm	82 mm
OD	117 (+2/-1) mm	117 mm	116 mm
T	≥ 6.7 mm	6.7 mm	8.81 mm
X	--	100 mm	101 mm
X1	--	140 mm	140 mm
Mass	8 (-1.2) kg	8 kg	7.7 kg

- Remarks : 1. Test result relates only to the specimen tested.
2. Test results of this sample comply with the requirement of BS437 : 2008, Annex A2 to A9, Clause 4.3 & 4.4 (effect of measurement uncertainty has not been taken into account).
3. Samples Submitted by : Asia Development (HK) Limited
4. Country of Origin : China

Test Certificate

Hydrostatic Test on Cast Iron Pipe

(In-house method based on BS 437 : 2008 Clause 1)

Date of issue : 18 December 2020

Page 1 of 1 page

Castco LRN : 201130-2279 HYD

Details as supplied by client

Customer : Cheung Hing Foundry (HK) Limited
Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong
Job title : --
Sample description : DN100 x 45° Bend with Flexible Joint
Brand name : CHF
Manufacturer : Cheung Hing Foundry (HK) Limited

Customer's ref. no. : --

Contract no. : --

Laboratory Test Result

Date received : 30 November 2020

Date of test : 01 December 2020

Specimen no.	201130-2279
Actual internal hydrostatic pressure applied (Bar)	3.5
Sustain period (sec)	30
Test result	Passed

- Remarks : 1. Test results relate only to the specimen tested (effect of measurement uncertainty has not been taken into account).
2. Samples Submitted by : Asia Development (HK) Limited
3. Country of Origin : China

Checked by:

SIT KWAN NING
Senior Supervisor

Form No. PIPE HYD In-house_T 44 03/06/2020 /06

Certified by:
End of ReportWONG KA MAN
Senior Manager

DIM

DIM

HYD

Test Report

Metallic Materials (Steel - Structural) - Brinell Hardness Test
(BS EN ISO 6506: Part 1: 1999)

Date of issue: 18 December 2020

Page 1 of 2 pages

Castco LRN: 201130-2279 BH

Details as supplied by customer:

Customer: Cheung Hing Foundry (HK) Limited

Customer's ref. no.:

Address: 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Contract no.:

Job title: --

Test piece description: DN100 x 45° Bend with Flexible Joint

Acceptance standard: BS 437: 2008 Clause 4.5 Table 4

Test piece no.: 1

Test results:


Date received: 30 November 2020

Date of test: 05 December 2020

Test specimen thickness: 12.12 mm

Test temperature: 20 °C

Sketch of Test locations

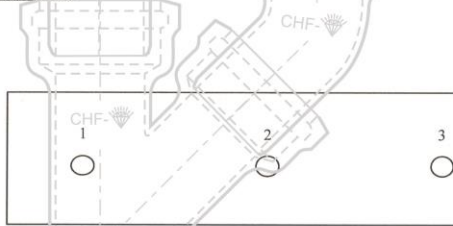

Test Report

Metallic Materials (Steel - Structural) - Brinell Hardness Test
(BS EN ISO 6506: Part 1: 1999)

Date of issue: 18 December 2020

Page 2 of 2 pages

Castco LRN: 201130-2279 BH

Test results:

Indentation no.	Indentation diameter (2 direct lines) (mm)	Indentation mean (n.m.)	Corresponding hardness value (HB)	Results
1	4.19	4.19	208	Passed
2	4.17	4.15	211	Passed
3	4.04	4.05	223	Passed

Testing Technique: Brinell hardness

- Hardness scale: HBW10/3000
- Force/diameter ratio: 30
- Load symbol: Newton
- Hold time: 12S
- Calibration with reference block prior to testing: Accept
- Surface finish: clean, smooth

Remarks: 1. Test results relate only to the specimen tested (effect of measurement uncertainty has not been taken into account).
2. Samples Submitted by: Asia Development (HK) Limited

Form No. NDT(ST) BH_MTL_T1 06/11/2018

Test Report

Metallic Materials - Tensile Test of Metallic Materials
(BS EN 10002-1: 2001)

Date of issue: 18 December 2020

Page 1 of 1 page

Castco LRN: 201130-2279 TEN

Details as supplied by customer:

Customer: Cheung Hing Foundry (HK) Limited

Customer's Ref. No.:

Address: 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Contract No.:

Job Title: --

Origin: copper tube: --

Supplier: --

Grade & Form of copper tube product: --

Location in work:

No. & Type of specimen supplied: 1 x DN100 x 45° Bend with Flexible Joint

Nominal thickness: 11.75 mm

Acceptance standard: BS 437: 2008 Clause 4.5 Table 4

Laboratory Test Results

Date Received: 30 November 2020

Date Tested: 05 December 2020

Tensile Test

Specimen Identity	Grade	Type & Preparation	Width (mm)	Thickness (mm)	Org. X-sect Area (mm ²)	Org. Gauge Length (mm)	Original Length (mm)	Tensile Strength (MPa)	Elongation (%)	Position of Fracture	Remark
201130-2279	--	--	8.08	11.75	94.94	--	--	110	--	Valid	--

Remarks:

- Legends: A - Proportional; B - Non-proportional; M - Machined; N - Unmachined; + This measurement is 'valid' which relates to the position of fracture only.
- Test results relate only to the specimen tested.
- Test results comply with BS 437: 2008 Clause 4.5 Table 4 (effect of measurement uncertainty has not been taken into account).
- Samples Submitted by: Asia Development (HK) Limited.
- Country of Origin: China
- Manufacturer: Cheung Hing Foundry (HK) Limited.

Checked by:

SIT KWAN NING
Senior Supervisor

Approved Signatory:

End of Report

WONG KA MAN
Senior Manager


Form No. ST BS EN 10002-1: 2001 T2 04 12/05/2017

Test Report
Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]

Page 2 of 2 page(s)

Castco LRN : 201130

Appendix

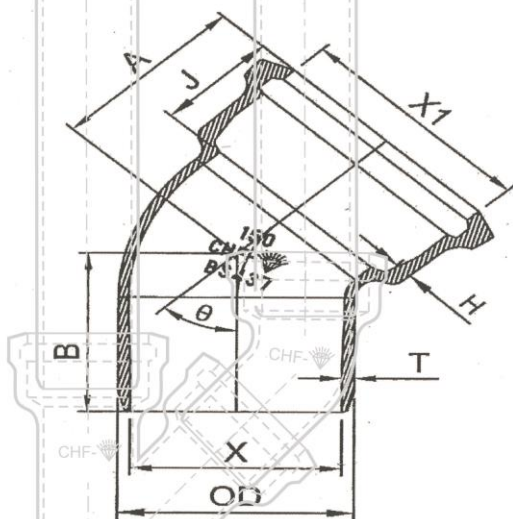香港粉嶺安樂街33號
香港粉嶺安樂街29A號
E-mail: info@castco.com.hk33, On Kui Street, Fanling, Hong Kong. Tel: 2597 8333
29A, On Chuen Street, Fanling, Hong Kong. Fax: 2597 8399
Website: www.castco.com.hk

Test Report

Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]Date of issue : 17 December 2020
Page 1 of 2 page(s)

Castco LRN : 201130-2280 DIM

Details as supplied by customer

Customer : Cheung Hing Foundry (HK) Limited
Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong
Job title : --

Customer's ref. no. : --

Contract no. : --

Sample description : DN150 x 45° Bend with Flexible Joint
Manufacturer : Cheung Hing Foundry (HK) Limited

Brand name : CHF

Nominal bore : 150 mm

Nominal Length: --

Nominal Mass: 13 kg

Type of joint: Flexible joint

Laboratory test result

Date sample received : 30 November 2020

Date of test : 01 December 2020

Dimensions Check

Specimen no. : 201130-2280

Dimensions	BS requirement from figure --	Product requirement from code no. --	Measured mean value
A	--	155 mm	154 mm
B	--	155 mm	155 mm
H	--	14 mm	12.20 mm
J	--	80 mm	84 mm
OD	1 (+2 -1) mm	171 mm	172 mm
T	≥ 7.7 mm	7.7 mm	10.67 mm
X	--	150 mm	150 mm
X1	--	190 mm	191 mm
Mass	13 (-1.95) kg	13 kg	12.9 kg

Remarks : 1. Test result relate only to the specimen tested.
2. Test result of this sample comply with the requirement of BS437 : 2008, Annex A2 to A9, Clause 4.3 & 4.4 (effect of measurement uncertainty has not been taken into account).
3. Samples Submitted by : Asia Development (HK) Limited
4. Country of Origin : China

Test Certificate

Hydrostatic Test on Cast Iron Pipe

(In-house method based on BS 437 : 2008 Clause 1)

Signature:

WONG KA MAN
Senior Manager

As listed in the HKQI/AS directory of accredited laboratories, original copy or the laboratory's certified true copy is valid.

Form No. PIPE DIM437_2008 T1 d4 31/07/2019

香港粉嶺安樂街33號得利中心6樓
香港粉嶺安樂街30號新寧中心1樓
香港粉嶺安樂街29A號
Tel: 2597 8333 Fax: 2597 8399

DIM

DIM

Date of issue : 18 December 2020
Page 1 of 1 page

Castco LRN : 201130-2280 HYD

Details as supplied by client

Customer : Cheung Hing Foundry (HK) Limited
Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Customer's ref. no. : --

Job title : --

Contract no. : --

Sample description : DN150 x 45° Bend with Flexible Joint

Brand name : CHF

Manufacturer : Cheung Hing Foundry (HK) Limited

Laboratory Test Result

Date received : 30 November 2020

Date of test : 01 December 2020

Specimen no.	201130-2280
Actual internal hydrostatic pressure applied (Bar)	3.5
Sustain period (sec)	30
Test result	Passed

Remarks : 1. Test results relate only to the specimen tested (effect of measurement uncertainty has not been taken into account).
2. Samples Submitted by : Asia Development (HK) Limited
3. Country of Origin : China

Checked by:

SIT KWAN NING
Senior Supervisor

Certified by:

End of Report

WONG KA MAN
Senior Manager

Form No. PIPE HYD In-house_T d4 03/06/2020 /06

香港粉嶺安樂街33號得利中心6樓 • 6/F, Techno Centre, 33, On Kui Street, Fanling, Hong Kong.
香港粉嶺安樂街30號新寧中心1樓 • 1/F, Sun Ling Plaza, 30, On Kui Street, Fanling, Hong Kong.
香港粉嶺安樂街29A號 • 29A, On Chuen Street, Fanling, Hong Kong.
Tel: 2597 8333 Fax: 2597 8399 E-mail: info@castco.com.hk Website: www.castco.com.hk


HYD

Test Report
Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
(BS 437 : 2008 Annex A2 to A5 (Clause 4.3 & 4.4))

Page 2 of 2 page(s)

Castco LRN : 201106

Appendix

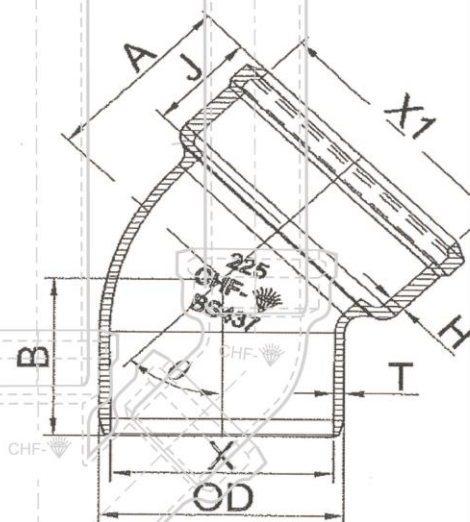

Form No. PIPE DIM437_2008 T1 dtd 31/07/2019

香港粉嶺安居街33號得利中心6樓
香港粉嶺安居街30號新寧中心1樓
香港粉嶺安居街29A號
Tel: 2597 8333 Fax: 2597 8399香港粉嶺安居街33號
香港粉嶺安居街29A號
E-mail: info@castco.com.hk33, On Kui Street, Fanling, Hong Kong. Tel: 2597 8333
29A, On Chuen Street, Fanling, Hong Kong. Fax: 2597 8399
Website: www.castco.com.hkTest Report
Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
(BS 437 : 2008 Annex A2 to A5 (Clause 4.3 & 4.4))

Date of issue : 20 November 2020

Page 1 of 2 page(s)

Castco LRN : 201106-2807 DIM

Details as supplied by customer

Customer : Cheung Hing Foundry (HK) Limited
Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong
Job title : --
Sample description : DN225 x 45° Bend with Flexible Joint
Manufacturer : Cheung Hing Foundry (HK) Limited
Brand name : CHF
Nominal bore : 225 mm
Nominal Length : --
Nominal Mass : 36 kg
Type of joint : Flexible joint

Customer's ref. no. : --

Contract no. : --

Laboratory test result

Date sample received : 05 November 2020

Date of test : 07 November 2020

Dimensions Check

Specimen no. : 201106-2807

Dimensions	BS Requirement from figure --	Product requirement from code no. --	Measured mean value
A	--	195 mm	190 mm
B	--	185 mm	180 mm
H	--	17 mm	17 mm
J	--	115 mm	118 mm
OD	54 (+2) mm	254 mm	256 mm
T	≥ 1.2 mm	10.2 mm	12.5 mm
X	224 mm	230 mm	230 mm
Y	--	276 mm	276 mm
Mass	36 (-5.4) kg	36 kg	35.5 kg

1. Test results relate only to the specimen tested.
2. Test results of the sample comply with the requirement of BS437 : 2008, Annex A2 to A5 (Clause 4.3 & 4.4) (effect of measurement uncertainty has not been taken into account).
3. Samples Submitted by : Asia Development (HK) Limited
4. Country of Origin : China

Test Certificate

Hydrostatic Test on Cast Iron Pipe

(In-house method in accordance with BS 437 : 2008 Clause 1)

Signatory :

WONG KA MAN
Senior ManagerFirm as listed in the HKAS directory of accredited laboratories.
Original copy or the laboratory's certified true copy is valid.

Date of issue : 20 November 2020

Page 1 of 1 page

Castco LRN : 201106-2807 HYD

Details as supplied by client

Customer : Cheung Hing Foundry (HK) Limited
Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong
Job title : --
Sample description : DN225 x 45° Bend with Flexible Joint
Brand name : CHF
Manufacturer : Cheung Hing Foundry (HK) Limited

Customer's ref. no. : --

Contract no. : --

Laboratory Test Result

Date received : 05 November 2020

Date of test : 07 November 2020

Specimen no.	201106-2807
Actual internal hydrostatic pressure applied (Bar)	3.5
Sustain period (sec)	30
Test result	Passed

- Remarks : 1. Test results relate only to the specimen tested. (Effect of measurement uncertainty has not been taken into account).
2. Samples Submitted by : Asia Development (HK) Limited
3. Country of Origin : China

Checked by :

SIT KWAN NING
Senior Supervisor

Certified by :

WONG KA MAN
Senior Manager

End of Report

Form No. PIPE HYD In-house_T dtd 03/06/2020


/06

Test Report
Dimension and Mass of Cast Iron Drain Pipes, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]

Page 2 of 2 page(s)

Castco LRN : 21020

Appendix

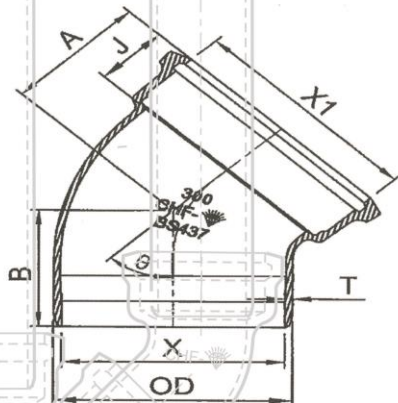香港粉嶺安居街33號
香港粉嶺安居街29A號
E-mail: info@castco.com.hk33, On Kui Street, Fanling, Hong Kong
29A, On Chuen Street, Fanling, Hong Kong
Website: www.castco.com.hkTest Report
Dimension and Mass of Cast Iron Drain Pipe, Fitting and Their Joints
[BS 437 : 2008 Annex A2 to A9 (Clause 4.3 & 4.4)]

Date of issue : 28 April 2021

Page 1 of 2 page(s)

Castco LRN : 210209-2851-001 DIM

Details as supplied by customer

Customer : Cheung Hing Foundry (HK) Limited
Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong
Job title : --

Customer's ref. no. : --

Contract no. : --

Sample description : DN300 x 45° Bend with Flexible Joint

Manufacturer : Cheung Hing Foundry (HK) Limited

Brand name : CHF

Nominal bore : 300 mm

Nominal Length : --

Nominal Mass : 39.5 kg

Type of joint : Flexible joint

Laboratory test result

Date sample received : 09 February 2021

Date of test : 18 February 2021

Dimensions Check

Specimen no. : 210209-2851-001

Dimensions	BS requirement from figure --	Product requirement from code no. BAD300A	Measured mean value
A	--	206 mm	208 mm
B	--	206 mm	210 mm
J	--	105 mm	108 mm
OD	--	322 mm	322 mm
T	--	9 mm	7.17 mm
X	--	300 mm	300 mm
X	--	346 mm	346 mm
Mass	39.5 (-5.93) kg	39.5 kg	40.5 kg

Remarks : Test result relates only to the specimen tested.

Compliance check against BS 437 : 2008, Annex A2 to A9 (Clause 4.3 & 4.4) was not possible as this fitting could not be found in the standard (effect of measurement uncertainty has not been taken into account).

3. Sample Submitted by : Asia Development (HK) Limited

Form No. PIPE DIM437_2008 T1 d4 31/07/2018 CHF/04

Test Certificate

Hydrostatic Test on Cast Iron Pipe

(In-house method based on BS 437 : 2008 Clause 1)

Date of issue : 28 April 2021

Page 1 of 1 page

Castco LRN : 210209-2851-001 HYD

Details as supplied by client

Customer : Cheung Hing Foundry (HK) Limited

Customer's ref. no. : --

Address : 299 Pak Sha Tsuen, Kung Um Road, Yuen Long, Hong Kong

Job title : --

Contract no. : --

Sample description : DN300 x 45° Bend with Flexible Joint

Brand name : CHF

Manufacturer : Cheung Hing Foundry (HK) Limited

Laboratory Test Result

Date received : 09 February 2021

Date of test : 18 February 2021

Specimen no.	210209-2851-001
Actual internal hydrostatic pressure apply (Bar)	3.5
Sustain period (sec)	30
Test result	Passed

Remark : 1. Test results relate only to the specimen tested (effect of measurement uncertainty has not been taken into account).
2. Sample Submitted by : Asia Development (HK) Limited.
3. Country of Origin : China

Checked by:

SIT KWAN NING
Senior Supervisor

Form No. PIPE HYD In-house_T1 d4 03/06/2020 /04

Certified by:
End of ReportWONG KA MAN
Senior Manager

